

28635: Drawdown from current location = 3.43 ft
Drawdown from proposed location = 4.91 ft
Net drawdown = **1.5 ft**


5195 & 5196: Drawdown from current location = 2.28 ft
Drawdown from proposed location = 3.00 ft
Net drawdown = **0.7 ft**

Domestic 3-30-39: Drawdown from current location = 3.08 ft
Drawdown from proposed location = 3.87 ft
Net drawdown = **0.8 ft**

Net drawdown does not exceed the drawdown allowance of 3.0 ft for any well within 1 mile of the proposed location. Therefore, critical well analysis is not necessary.

Conclusion:

The proposed move is likely to create minimal effects on neighboring wells and appears unlikely to cause impairment. Any concerned neighbors should contact GMD3 at (620) 275-7147 or the Division of Water Resources at (620) 276-2901.

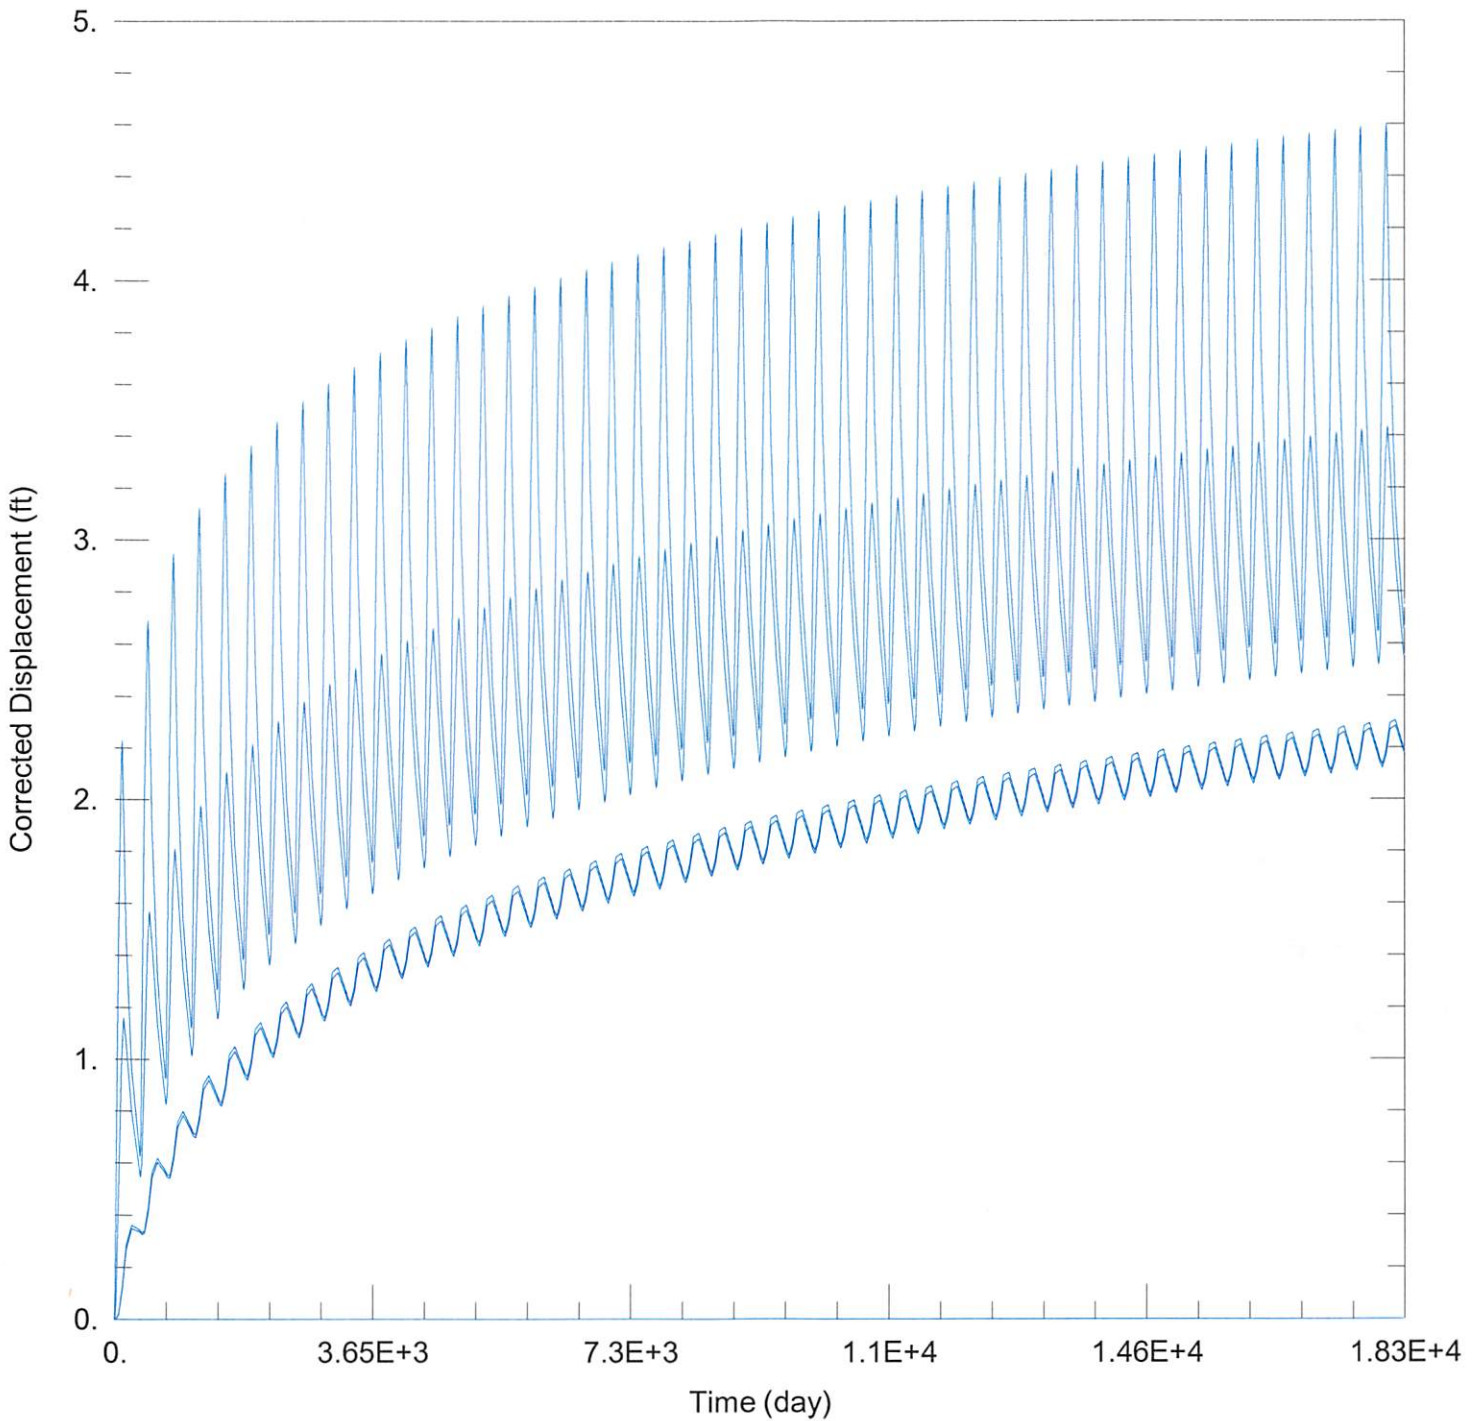

WELL TEST ANALYSIS

Data Set: C:\Users\trevora\Documents\2023_moves\15261_15262\15261 & 15262 Current.aqt
 Date: 03/01/23 Time: 15:03:27

PROJECT INFORMATION

Company: GMD 3
 Project: 15261 & 15262
 Location: Stanton County


WELL DATA

Pumping Wells

Observation Wells

Well Name	X (ft)	Y (ft)
15261 & 15262	-226054	219520

Well Name	X (ft)	Y (ft)
□	-226054	219520

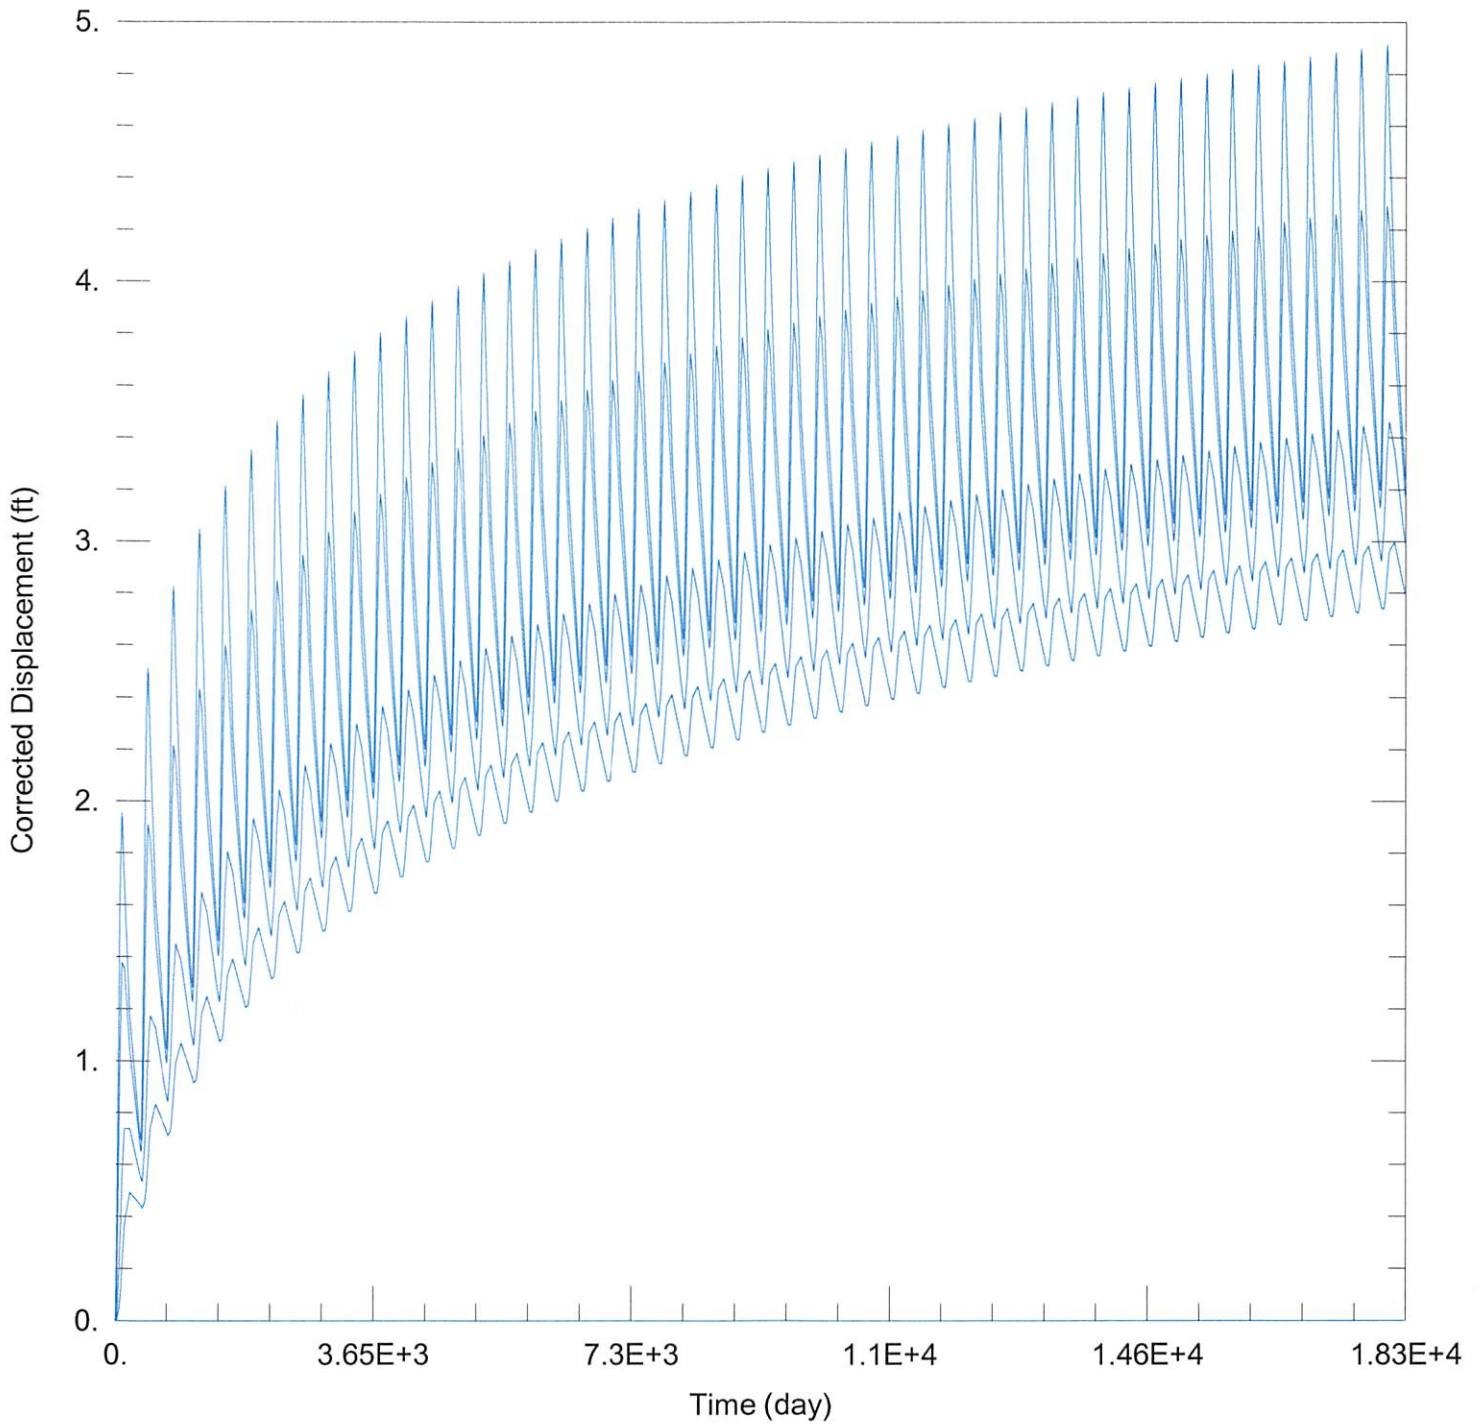

WELL TEST ANALYSIS

Data Set: C:\Users\trevora\Documents\2023_moves\15261_15262\15261 & 15262 Proposed.aqt
 Date: 03/01/23 Time: 15:03:18

PROJECT INFORMATION

Company: GMD 3
 Project: 15261 & 15262
 Location: Stanton County

WELL DATA

Pumping Wells

Observation Wells

Well Name	X (ft)	Y (ft)
15261 & 15262	-226516	217066

Well Name	X (ft)	Y (ft)
□	-226516	217066